## **SIEMENS**

## **Data sheet**

## 3SU1400-1LL10-1BA1



SIRIUS ACT with PROFINET: fail-safe interface module with 4 DI, 1 DQ (24 V DC), 1 AI (12-bit A/D resolution), 24 V DC, screw terminal, front plate mounting, 1 to 20 terminal modules connectable

| product brand name   | SIRIUS ACT  |  |  |
|--|---|--|--|
| product designation  | Fail-safe interface module for PROFINET                                 |  |  |
| product type designation   | 3SU1  |  |  |
| Display  |   |  |  |
| display version  |   |  |  |
| <ul> <li>for diagnostic function: Supply voltage monitoring power<br/>LED</li> </ul> | Yes   |  |  |
| <ul> <li>status Tx/Rx link</li> </ul>  | Yes   |  |  |
| General technical data   |   |  |  |
| product function   |   |  |  |
| <ul> <li>reverse polarity protection</li> </ul>                                      | Yes; With polarity change, DI1 DI4 may not be connected to (M) pole     |  |  |
| <ul> <li>diagnostics function</li> </ul>   | Yes   |  |  |
| • alarms   | Yes   |  |  |
| • I&M data   | Yes; I&M0 I&M3  |  |  |
| firmware version   | 2.1.4   |  |  |
| hardware version   | 1   |  |  |
| configuration function with dataset  | Yes   |  |  |
| software version with STEP 7 in the TIA Portal required                              | Integrated in TIA Portal Version 14 SP1 or higher (HSP for V13 and V14) |  |  |
| number of units per rack maximum   | 20  |  |  |
| number of submodules per station maximum   | 24  |  |  |
| power loss [W] typical   | 0.67 W  |  |  |
| insulation voltage rated value   | 30 V  |  |  |
| degree of pollution  | 3   |  |  |
| type of voltage  |   |  |  |
| <ul> <li>of the operating voltage</li> </ul>   | DC  |  |  |
| of the input voltage   | DC  |  |  |
| surge voltage resistance rated value   | 0.8 kV  |  |  |
| consumed current   |   |  |  |
| • maximum  | 100 mA  |  |  |
| rated value  | 28 mA   |  |  |
| protection class IP  | IP20, clamping screw tightened  |  |  |
| shock resistance   |   |  |  |
| <ul> <li>according to IEC 60068-2-27</li> </ul>                                      | sinusoidal half-wave 15g / 11 ms  |  |  |
| <ul> <li>for railway applications according to EN 61373</li> </ul>                   | Category 1, Class B   |  |  |
| vibration resistance   |   |  |  |
| <ul> <li>according to IEC 60068-2-6</li> </ul>                                       | 10 500 Hz: 5g   |  |  |
| <ul> <li>for railway applications according to EN 61373</li> </ul>                   | Category 1, Class B   |  |  |
| reference code according to IEC 81346-2  | К   |  |  |
| Substance Prohibitance (Date)  | 12/19/2016  |  |  |
| SVHC substance name  | Blei - 7439-92-1<br>Bleimonoxid (Bleioxid) - 1317-36-8                  |  |  |

|   | 2-Methyl-1-(4-methylthiophenyl)-2-morpho - 71868-10-5<br>Bleititanzirkonoxid - 12626-81-2 |  |  |
|---|---|--|--|
|   | 2,2',6,6'-Tetrabrom-4,4'-isopropylidendi - 79-94-7  |  |  |
| operating voltage rated value   | 20.4 V  |  |  |
| I2t value   | 0.008 A²·s  |  |  |
| Supply voltage  | 0.00071 0   |  |  |
| supply voltage at DC rated value  | 24 V  |  |  |
| Communication/ Protocol   | Z4 V  |  |  |
|   |   |  |  |
| protocol is supported   | V   |  |  |
| PROFINET IO protocol  | Yes   |  |  |
| PROFIsafe protocol  | Yes   |  |  |
| product function at the Ethernet interface  |   |  |  |
| <ul> <li>Autocrossover</li> </ul>   | Yes   |  |  |
| Autonegotiation   | Yes   |  |  |
| protocol at the 1st interface media redundancy protocol                               | No  |  |  |
| product function at the 1st interface PROFINET IO device                              | Yes   |  |  |
| product function of the PROFINET IO device is supported<br>PROFINET system redundancy | No  |  |  |
| service as PROFINET IO device   |   |  |  |
| <ul> <li>prioritized startup</li> </ul>   | No  |  |  |
| • isochronous mode  | No  |  |  |
| <ul> <li>supports Shared Device</li> </ul>  | No  |  |  |
| <ul> <li>supports PROFlenergy</li> </ul>  | No  |  |  |
| • IRT   | No  |  |  |
| • MRP   | No  |  |  |
| • MRPD  | No  |  |  |
| service for open IE communication   |   |  |  |
| • LLDP  | Yes   |  |  |
| • SNMP  | Yes   |  |  |
| • TCP/IP  | Yes   |  |  |
| GSD version/revision with PROFINET required   | V2.34   |  |  |
| transmission mode for Industrial Ethernet   | PROFINET with 100 Mbps full duplex (100BASE-TX)   |  |  |
| network load class according to PROFINET  | 1   |  |  |
| specification for Security Level 1 test according to PROFINET                         | Resilient to network loading  |  |  |
| Control circuit/ Control  |   |  |  |
| inrush current maximum  | 16 A  |  |  |
| Galvanic isolation  |   |  |  |
| galvanic isolation between PROFINET and all other circuits                            | Yes   |  |  |
| Inputs/ Outputs   |   |  |  |
| number of digital inputs  | 4   |  |  |
| safety-related  | 0   |  |  |
| number of analog inputs   | 1   |  |  |
| number of digital outputs   | 1   |  |  |
| Connections/ Terminals  |   |  |  |
| type of electrical connection   | screw-type terminals  |  |  |
| connectable conductor cross-section for auxiliary contacts                            | osion type terminals  |  |  |
| solid or stranded   | 0.2 2.5 mm²   |  |  |
|   | 2.5 mm <sup>2</sup>   |  |  |
| finely stranded with core end processing  connectable conductor cross section         | Z.J IIIII   |  |  |
| connectable conductor cross-section   | 0.2 2.5 mm²   |  |  |
| • solid   | 0.2 2.5 mm <sup>2</sup>   |  |  |
| solid with core end processing  | 0.2 2.5 mm <sup>2</sup>   |  |  |
| finely stranded with core end processing  | 0.25 2.5 mm <sup>2</sup>  |  |  |
| finely stranded without core end processing   | 0.2 2.5 mm <sup>2</sup>   |  |  |
| AWG number as coded connectable conductor cross section                               | 30 12   |  |  |
| tightening torque with screw-type terminals   | 0.5 0.6 N·m   |  |  |
| Safety related data   |   |  |  |
| service life maximum  | 20 a  |  |  |
|   |   |  |  |
| IEC 62061   |   |  |  |
| PFHD with high demand rate according to EN 62061 ISO 13849                            | 5.951E-10 1/h   |  |  |

| performance level (PL) according to ISO 13849-1                               | е   |   |                           |  |  |
|---|---|---|---------------------------|--|--|
| category according to ISO 13849-1   | 4   |   |                           |  |  |
| IEC 61508   |   |   |                           |  |  |
| Safety Integrity Level (SIL) according to IEC 61508                           | 3   |   |                           |  |  |
| PFDavg with low demand rate according to IEC 61508                            | 2.426E-6  |   |                           |  |  |
| Safe failure fraction (SFF)   | 99.6 %  |   |                           |  |  |
| T1 value according to IEC 61508   | 1 a   |   |                           |  |  |
| Interfaces  |   |   |                           |  |  |
| design of the interface   |   |   |                           |  |  |
| Ethernet interface  | Yes; for Ethernet services  |   |                           |  |  |
| Fast Ethernet interface   | Yes; PROFINET with 100 Mbps   |   |                           |  |  |
| interface design 1  |   |   |                           |  |  |
| <ul> <li>integrated switch</li> </ul>   | No  |   |                           |  |  |
| RJ45 (Ethernet)   | Yes   |   |                           |  |  |
| number of ports at the 1st interface  | 1   |   |                           |  |  |
| number of interfaces according to PROFINET                                    | 1   |   |                           |  |  |
| Ambient conditions  |   |   |                           |  |  |
| ambient temperature   |   |   |                           |  |  |
| <ul> <li>during operation</li> </ul>  | -25 +60 °C  |   |                           |  |  |
| during storage  | -40 +80 °C  |   |                           |  |  |
| environmental category during operation according to IEC 60721                | 3M6, 3S2, 3B2, 3K6 (with relative air humidity of 10 95%, no condensation in operation permitted) |   |                           |  |  |
| explosion protection marking for intrinsic safety of related equipment EEx ia | No  |   |                           |  |  |
| explosion protection marking for intrinsic safety of related equipment EEx ib | No  |   |                           |  |  |
| Environmental footprint   |   |   |                           |  |  |
| Environmental Product Declaration(EPD)  | Yes   |   |                           |  |  |
| Global Warming Potential [CO2 eq] total                                       | 0.787   | 0.787 kg                                      |                           |  |  |
| Global Warming Potential [CO2 eq] during manufacturing                        | 0.566 kg  |   |                           |  |  |
| Global Warming Potential [CO2 eq] during operation                            | 0.235   | 0.235 kg                                      |                           |  |  |
| global warming potential [CO2 eq] after end of life                           | -0.015 kg   |   |                           |  |  |
| Installation/ mounting/ dimensions  |   |   |                           |  |  |
| fastening method of modules and accessories                                   | Front   | Front plate mounting                          |                           |  |  |
| height  | 80.1 m  | 80.1 mm                                       |                           |  |  |
| width   | 40 mm   |   |                           |  |  |
| depth   | 72.1 mm   |   |                           |  |  |
| Approvals Certificates  |   |   |                           |  |  |
| General Product Approval  |   | Functional<br>Safety/Safety of Ma-<br>chinery | Declaration of Conformity |  |  |

Confirmation





Type Examination Certificate





Test Certificates other Environment

<u>Special Test Certific-</u> <u>Type Test Certific-</u> <u>Confirmation</u> <u>PROFIsafe-Certifica-</u> <u>Environmental Confirmations</u> <u>tion</u> <u>firmations</u>

## Further informatior

Siemens has decided to exit the Russian market (see here).

https://press.siemens.com/global/en/pressrelease/siemens-wind-down-russian-business

Siemens is working on the renewal of the current EAC certificates.

Please contact your local Siemens office on the status of validity of the EAC certification if you intend to import or offer to supply these products to an EAC relevant market (other than the sanctioned EAEU member states Russia or Belarus).

Information on the packaging

 $\underline{\text{https://support.industry.siemens.com/cs/ww/en/view/109813875}}$ 

Information- and Downloadcenter (Catalogs, Brochures,...)

https://www.siemens.com/ic10

Industry Mall (Online ordering system)


https://mall.industry.siemens.com/mall/en/en/Catalog/product?mlfb=3SU1400-1LL10-1BA1


Cax online generator


 $\underline{http://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en\&mlfb=3SU1400-1LL10-1BA100-1BA100-1B$ 

Service&Support (Manuals, Certificates, Characteristics, FAQs,...) https://support.industry.siemens.com/cs/ww/en/ps/3SU1400-1LL10-1BA1

Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...) http://www.automation.siemens.com/bilddb/cax\_de.aspx?mlfb=3SU1400-1LL10-1BA1&lang=en

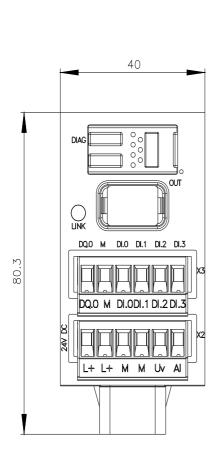

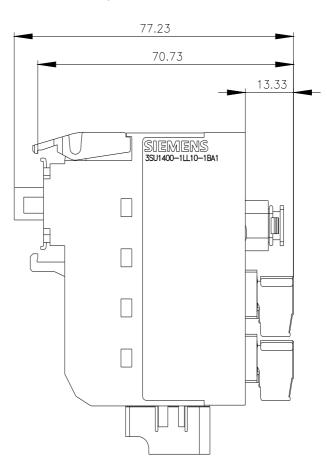

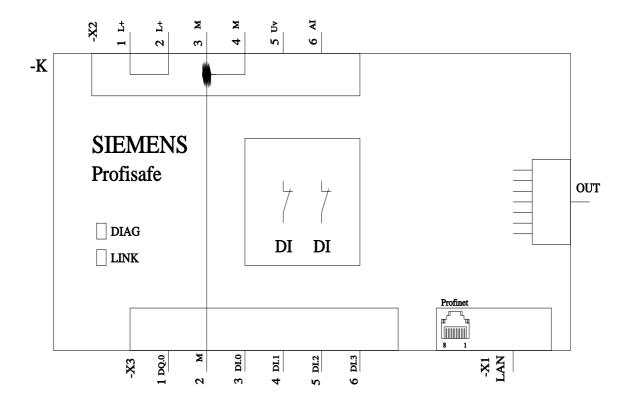

last modified: 11/9/2023 🖸