



DIRIS G

RS485 to Ethernet communication gateways

Communication interfaces



Function

With communication gateways **DIRIS G** all the information from meters and power monitors, communicating by RS485, is centralized and made available on the Ethernet Modbus (TCP).

DIRIS G gateways can retrieve data from meters or Socomec remote measuring points via Ethernet.

The gateway has an embedded WEBVIEW web server, allowing real time monitoring of electrical values and analysis of consumption data. The user can be alerted of any alarms via email.

Advantages

WEBVIEW⁽¹⁾ embedded web server

DIRIS G gateways include an embedded web server. Two versions are available:

- Power Monitoring:
 - Realtime measurements and alerts.
- Power & Energy Monitoring:
 - Realtime measurements and alerts.
 - Trends for selected parameters and energy consumption history and analysis.

Scalable

Several optional modules are available:

- Digital inputs/outputs.
- Analogue inputs/outputs.
- Temperature inputs.

(1) See page 278.

Selection guide

	Gateway	DIRIS G-30	DIRIS G-50
Communication	RS485 Modbus	•	•
	Ethernet	•	•
WEBVIEW embedded web server	Power Monitoring	•	•
	Power & Energy Monitoring		•



The solution for

- Industry
- Building
- Infrastructure
- Local authority



Strong points

- WEBVIEW embedded web server
- Scalable
- Plug & Play



Compliance with standards

- UL 61010 guide PICQ file E257746
- IEC 61010
- ISO 14025


Functions

DIRIS G-30 / DIRIS G-50

- RS485 and Ethernet ports (2 ports with integrated switch)
- Automatic addressing and detection of connected devices.
- Historical of measurements: max 1 year (DIRIS G-50 only)
- Internal clock (SNTP synchronization)
- Sending of alarm by email (SMTP)
- WEBVIEW embedded web server

Architecture

Example of communication architecture with DIRIS G gateway and WEBVIEW embedded WEB server

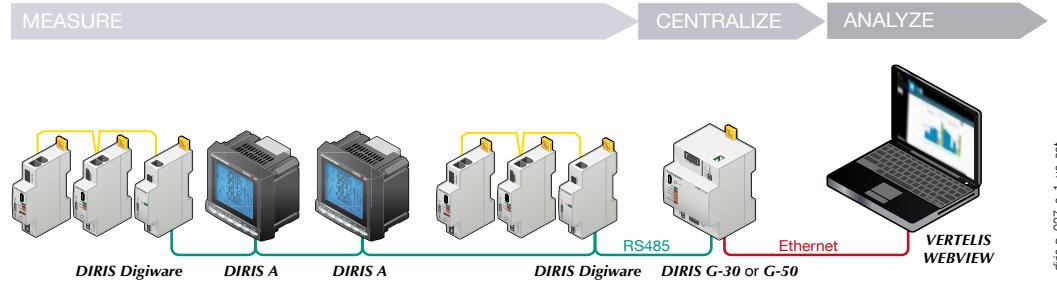

diris-q-027-a_1_us.cat

Embedded web server

WEBVIEW⁽¹⁾ embedded web server

- Version Power Monitoring:
embedded in DIRIS G-30
- Version Power & Energy Monitoring:
embedded in DIRIS G-50
- 32 devices max



(1) For further details see page 278.

DIRIS O optional modules

a maximum of 4 optional modules can be connected to a DIRIS G gateway in order to integrate controls/ commands.

DIRIS O-iod	2 digital inputs / 2 digital outputs
DIRIS O-ioa	2 analogue inputs / 2 analogue outputs
DIRIS O-it	3 temperature inputs

For more information see "DIRIS O optional modules"



Accessories

USB configuration cable


- Configuration of DIRIS G gateways can be achieved using EASY CONFIG software via Ethernet or direct USB connection.

Accessories Description	To be ordered in multiples of	Part number
Fuse holder Class CC to protect voltage inputs 3 pole Class CC 0.5 A fuses	4	5705 0003
	10	6000 5000


DIRIS G

RS485 to Ethernet communication gateways

DIRIS G terminals

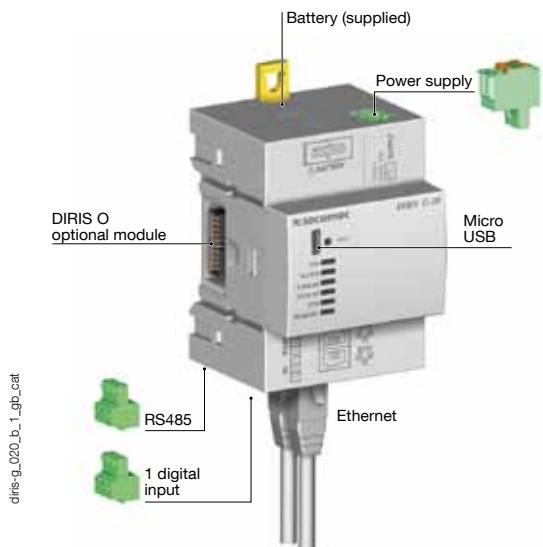


Power supply




NC: not connected


Input powered by the product



Input with external power supply



RS485




Terminals of DIRIS O optional modules


Optional modules are common to the DIRIS B-30 monitoring device.
For a description of the terminals see page 270.

Dimensions (in/mm)

DIRIS G-30 / G-50

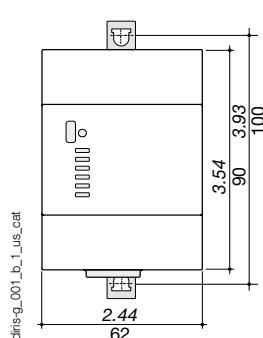

DIRIS O optional modules

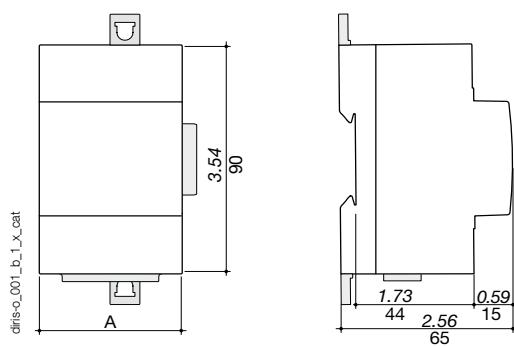

DIRIS O optional modules

DIRIS O-iod - DIRIS O-ia - DIRIS O-it

A

45 mm

Specifications

Mechanical specifications		Ethernet	
Casing type	DIN-rail mounting module and base	Link	Ethernet 10/100 base-T, 2 RJ45 bases with integrated switch
Case degree of protection	IP20 / IK06	Protocol	Modbus TCP (port 502), Modbus RTU over TCP (port 503), HTTP, SMTP, SNTP, DHCP, FTP (G-50)
Front degree of protection	IP40 on the nose in modular assembly / IK08	Clock	Internal
Weight	DIRIS G-30, G-50 = 6.7 oz / 190 g	SNTP protocol	Gateway time updating from an NTP server. Connected PMDs time updating.
Electrical characteristics		SMTP protocol	Sending of alarm emails from the gateway
Power supply		Function	Configuration of the gateway, connected PMDs and meters Access to the WEBVIEW web server, data centralization
Alternative voltage	110-230 VAC ±15% (Ph/N or Ph/Ph) Cat III	USB	
Frequency	50/60 Hz	Connection type	USB 2 (required installation of Easy Config)
Power consumption	6 VA	Protocol	Modbus RTU on USB
Battery	CR 1220 3 V lithium button cell battery	Function	Configuration of the gateway, connected PMDs and meters
Input		Connection	Type B micro USB connector
Number	1	Memory characteristics	
Type / Power supply	Optocoupler internal polarization (12 VDC ±10%) or external (10-30 VDC ±10%)	Consumption history (memory extension for meters and measurement units)	1 year (1 hour period)
Input function	Logic status, pulse meter or synchronization pulse status	Electrical values	2 months (10 min period)
Communication specifications			
DIRIS G		Number of events	Alarms 1000 Network quality according to EN 50160: 1000
Link	RS485	Environmental specifications	
Connection type	2 ... 3 half duplex wires	Ambient operating temperature	-10 ... +70 °C / +14 °F ... +158 °F
Protocol	Modbus RTU	Storage temperature	-25 ... +85 °C / -13 °F ... +185 °F
Baudrate	2400 ... 115200 bauds	Operating humidity	55 °C / 131 °F / 97% relative humidity
Function	Communication with PMDs and meters		

References

		Reference
DIRIS G gateways		
DIRIS G-30	RS485 / Ethernet - WEBVIEW Power Monitoring	4829 0300
DIRIS G-50	RS485 / Ethernet - WEBVIEW Power & Energy Monitoring	4829 0302
DIRIS O optional modules		Reference
DIRIS O-iod	2 digital inputs / 2 digital outputs	4829 0030
DIRIS O-ioa	2x 4-20 mA analogue inputs / 2x 4-20 mA analogue outputs	4829 0031
DIRIS O-it	3 temperature inputs, PT100/PT1000	4829 0032
Accessories		To be ordered in multiples of
USB configuration cable		
Fuse circuit breakers to protect the auxiliary power supply (type RM) 1 pole + neutral	6	5601 0017
gG 10x38 0.5 A fuses	10	6012 0000



1-800-517-8431

99 Washington Street
 Melrose, MA 02176
 Phone 781-665-1400
 Toll Free 1-800-517-8431

Visit us at www.TestEquipmentDepot.com